

Report No.: 1

Test Time: 2016-12-28 14:29

Luminaire Property

Luminaire Category: 0114.W.A311.6
Luminaire Description: 60065
Length (mm): 136
Height (mm): 3
Current: 0.063 A
Power Factor: 0.982

Luminaire Manufacturer: Brasled
Width (mm): 136
Voltage: 230.1 V
Power: 14.35 W

Photometric Results


CIE Class: Direct
Measurement Flux: 1002.4 lm
Downward Ratio: 100%
Field Angle: H83.7 V83.7
Luminaire Efficacy Rating (LER): 70
Max. Intensity: 1282.99 cd

Total Rated Lamp Lumens: 1002.4 lm
Efficiency: 100%
Upward Ratio: 0%
Beam Angle: H52.0 V52.0
Central Intensity: 1282.37 cd
Pos of Max. Intensity: H90 V0

Picture Of Luminaire



Luminous Intensity Distribution Curve

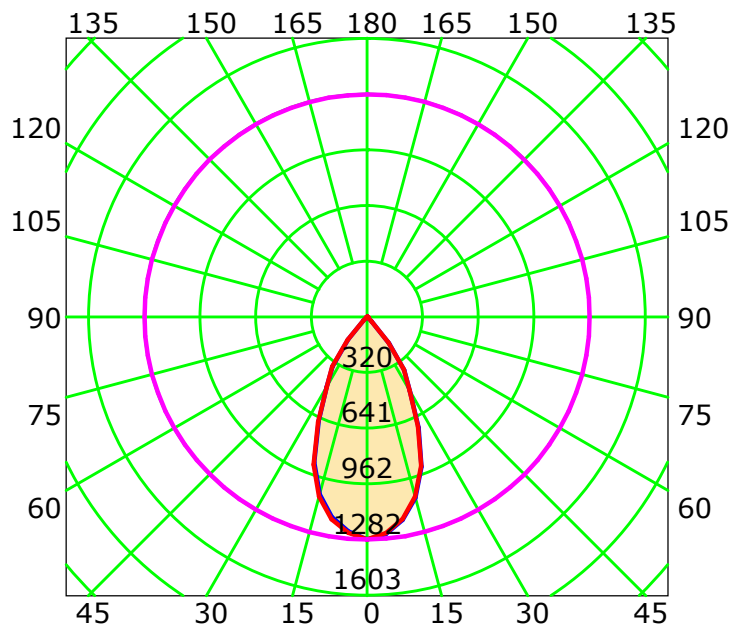



Average Diffuse Angle(50%): 52.0° Unit: cd

— C0-C180 — C90-C270 — G0

C Plane (°):0.0-360.0: 22.5
Test Lab: Brasled
Test Type: TYPE C
Temperature: 26
Operator:

Gamma Plane (°):0.0-90.0:5.0
Test Device: LSG-1200A
Distance: 1.0 m
Humidity: 60
Inspector:

Luminous Intensity Distribution Curve

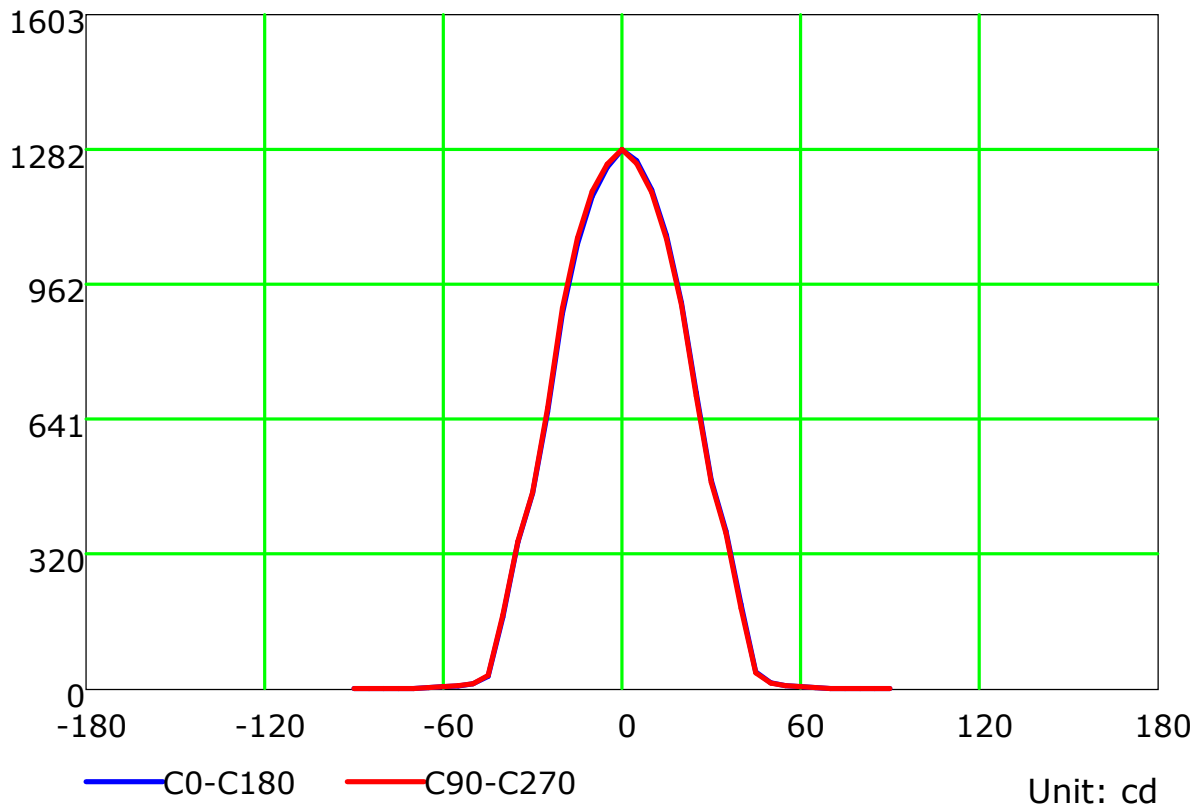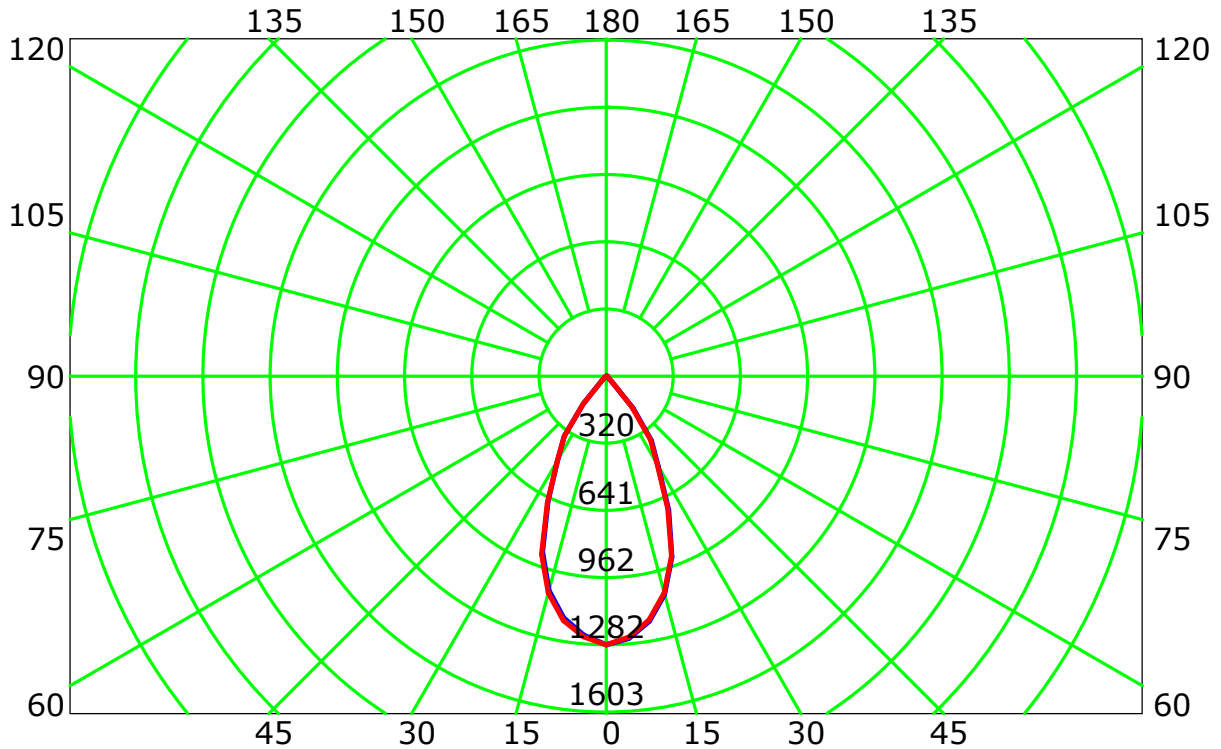


C Plane (°): 0.0-360.0: 22.5
 Test Lab: Brasled
 Test Type: TYPE C
 Temperature: 26
 Operator:

Gamma Plane (°): 0.0-90.0: 5.0
 Test Device: LSG-1200A
 Distance: 1.0 m
 Humidity: 60
 Inspector:

Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	111	109	106	111	109	107	105	105	103	101	101	100	98	98	97	96	94
2	108	103	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	85	83	82
4	98	91	85	81	96	89	84	81	87	83	80	85	82	79	83	80	78	76
5	93	85	79	75	91	84	79	75	82	78	74	81	77	73	79	76	73	71
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63
8	80	71	65	61	79	70	65	61	69	64	61	68	64	61	67	63	60	59
9	77	67	61	58	76	67	61	57	66	61	57	65	60	57	64	60	57	56
10	73	64	58	54	72	63	58	54	62	57	54	62	57	54	61	57	54	52


Spacing Criteria (0-180): 0.82
 Spacing Criteria (90-270): 0.82
 Spacing Criteria (Diagonal): 0.81

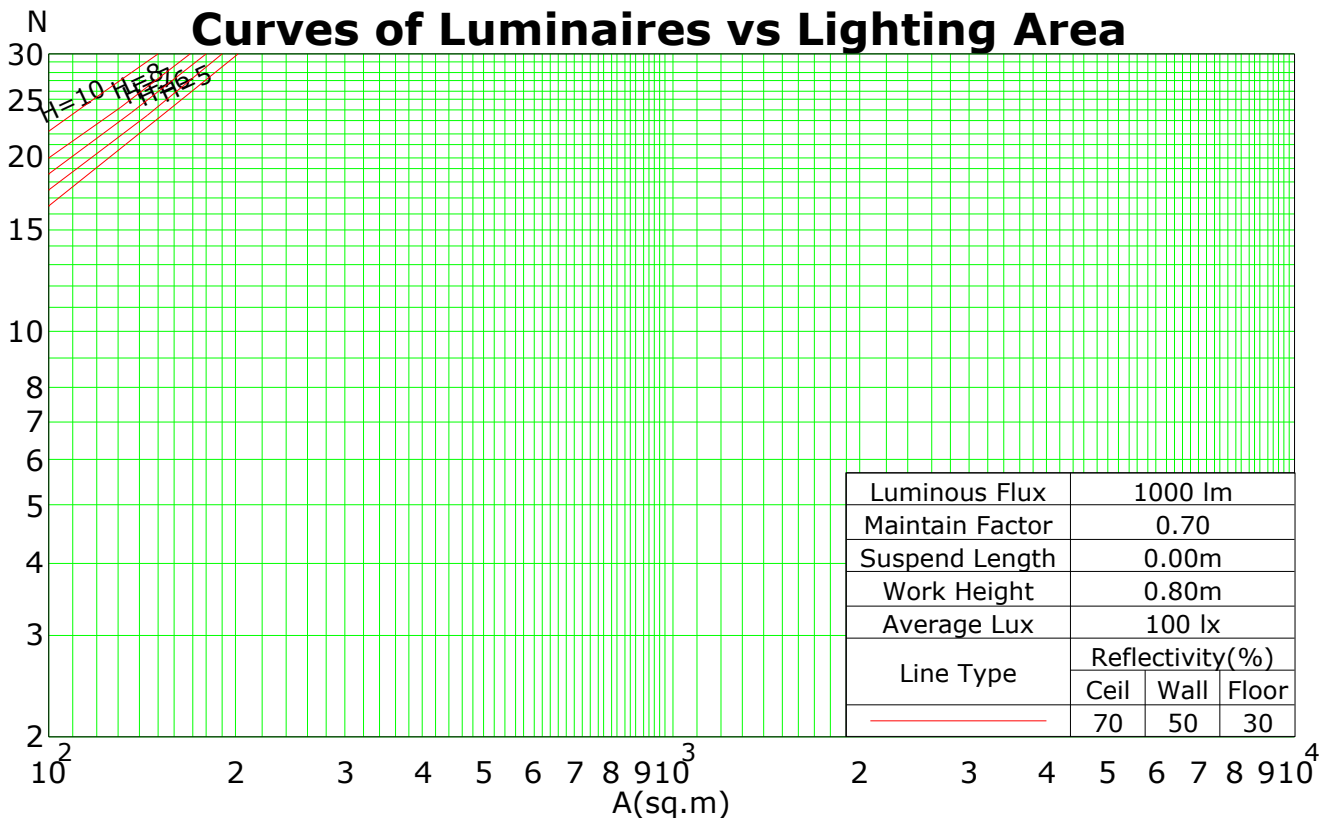

C Plane (°):0.0-360.0: 22.5
 Test Lab: Brasled
 Test Type: TYPE C
 Temperature: 26
 Operator:

Gamma Plane (°):0.0-90.0:5.0
 Test Device: LSG-1200A
 Distance: 1.0 m
 Humidity: 60
 Inspector:

Isocandela (rectangle)

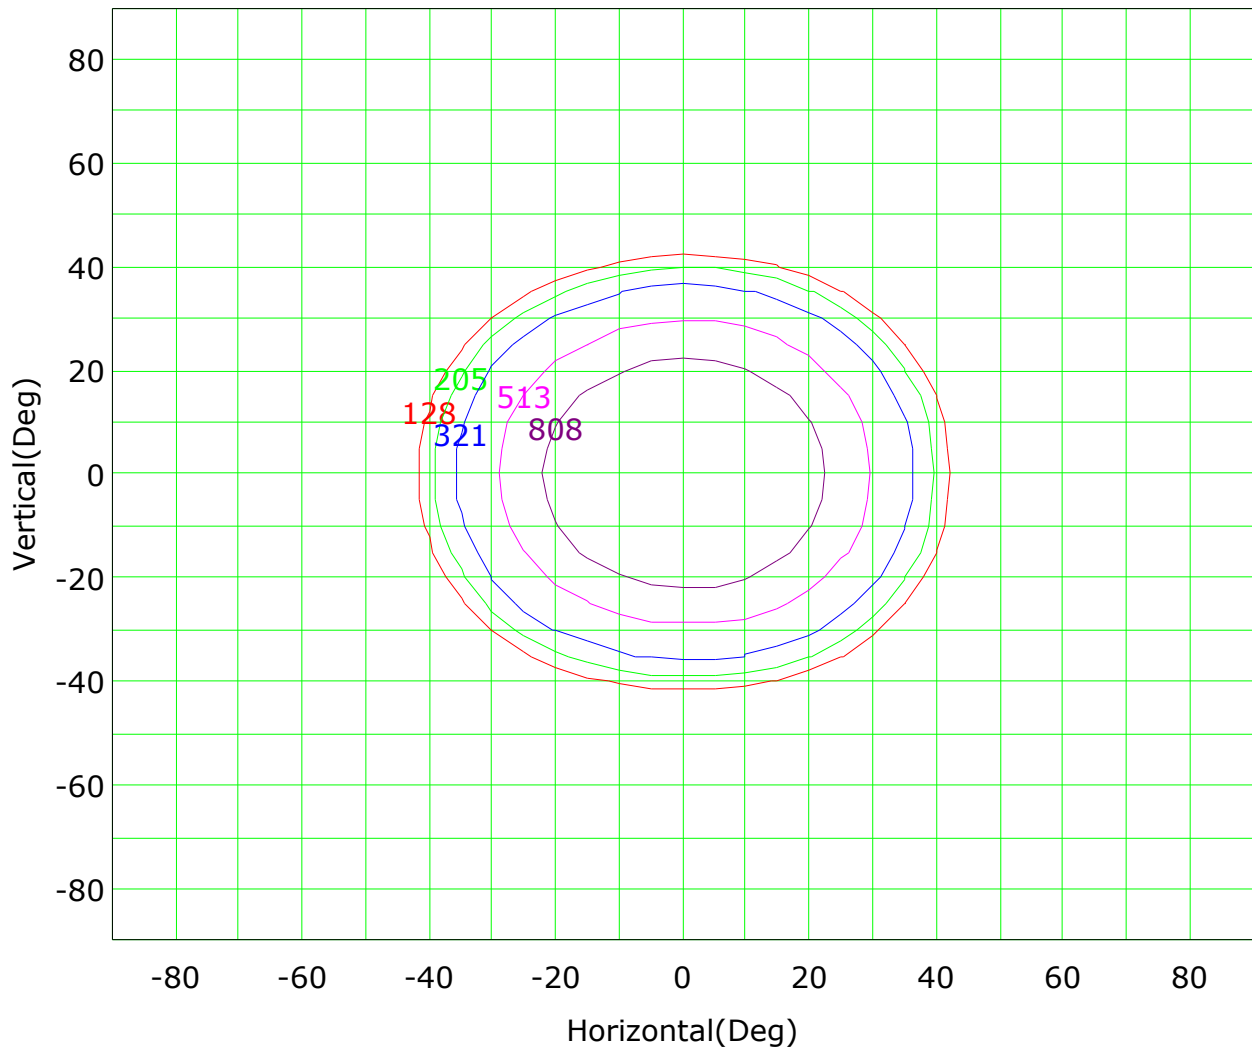


Imax (100%): 1283 cd

— (10%):	128 cd	— (16%):	205 cd
— (25%):	321 cd	— (40%):	513 cd
— (63%):	808 cd	— (100%):	1283 cd

C Plane (°):0.0-360.0: 22.5
Test Lab: Brasled
Test Type: TYPE C
Temperature: 26
Operator:

Gamma Plane (°):0.0-90.0:5.0
Test Device: LSG-1200A
Distance: 1.0 m
Humidity: 60
Inspector:

IsoLux Plot

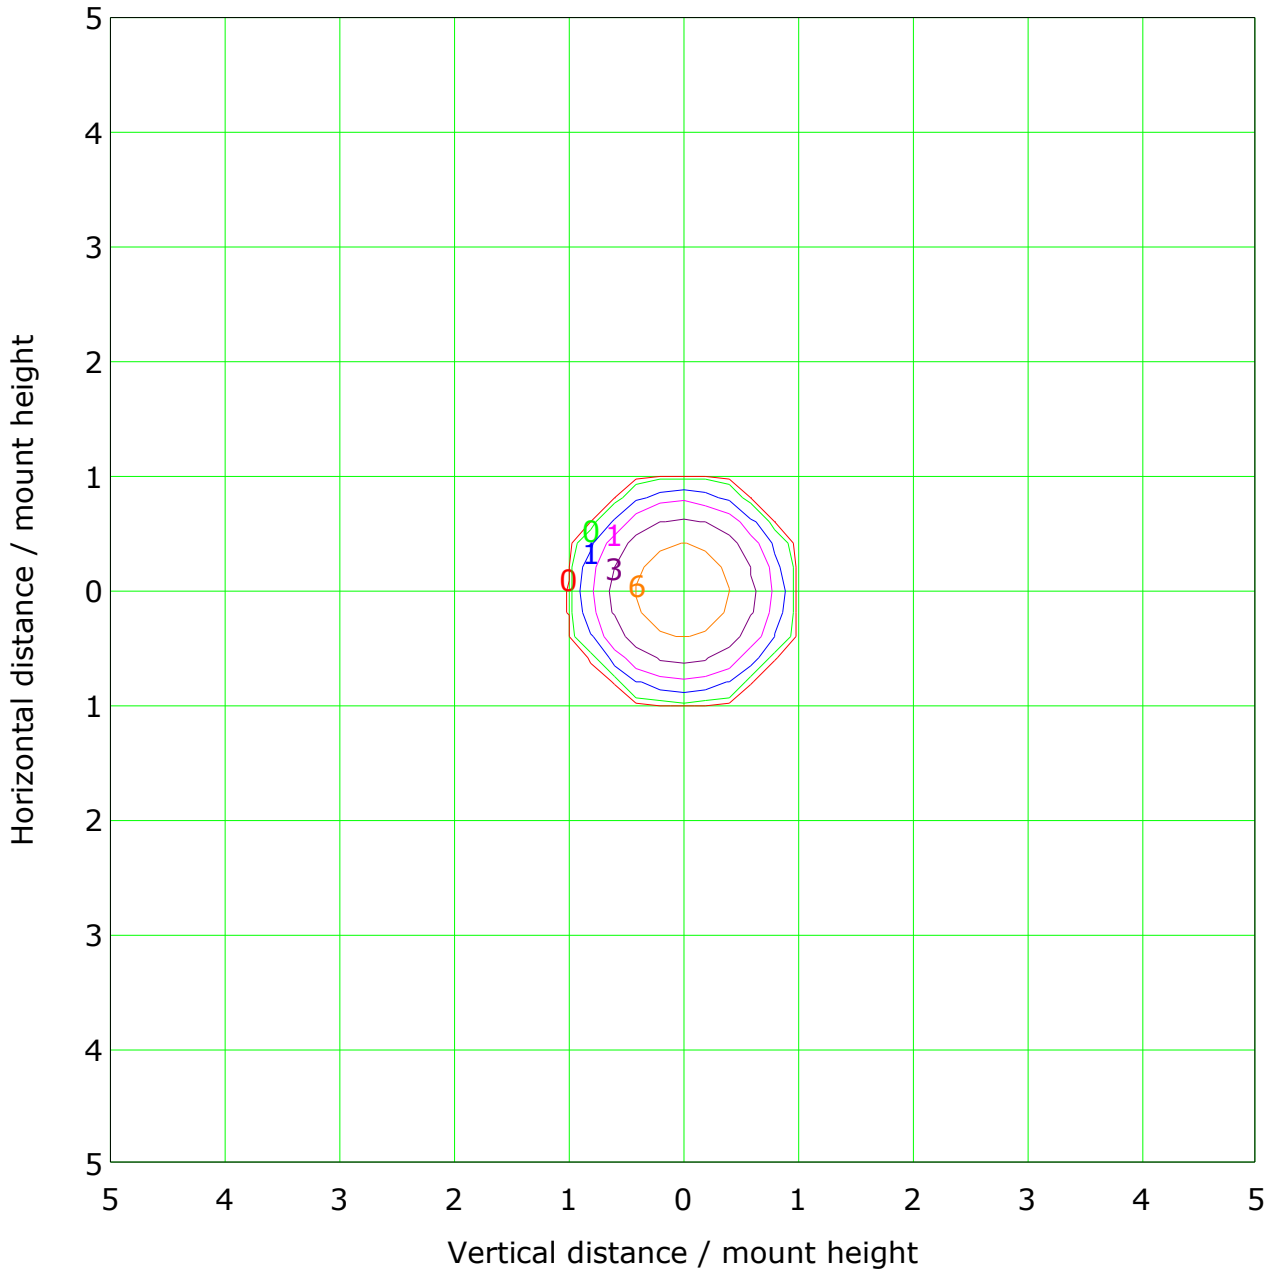

Mounting Height: 10.0m		Max Lux(100%): 12.8 lx	
— (1%):	0.1 lx	— (2%):	0.3 lx
— (5%):	0.6 lx	— (10%):	1.3 lx
— (20%):	2.6 lx	— (50%):	6.4 lx
— (100%):	12.8 lx		



C Plane (°):0.0-360.0: 22.5
 Test Lab: Brasled
 Test Type: TYPE C
 Temperature: 26
 Operator:

Gamma Plane (°):0.0-90.0:5.0
 Test Device: LSG-1200A
 Distance: 1.0 m
 Humidity: 60
 Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)								
		2000	1000	500	<=300					
1.15	A									
1.50	B									
1.85	C									
2.20	D									
2.55	E									

a b c d e f g h

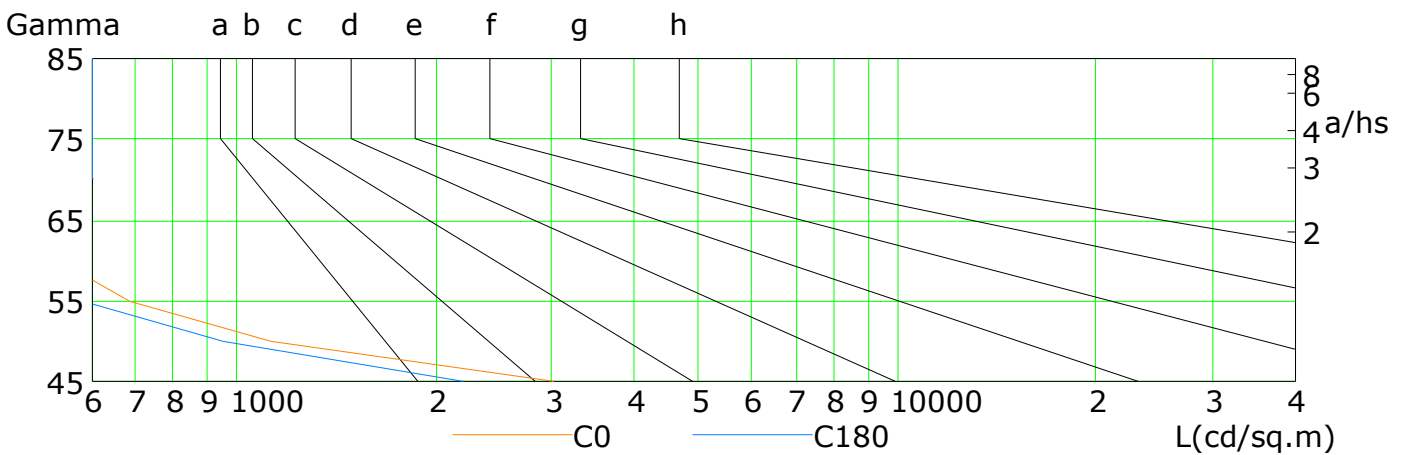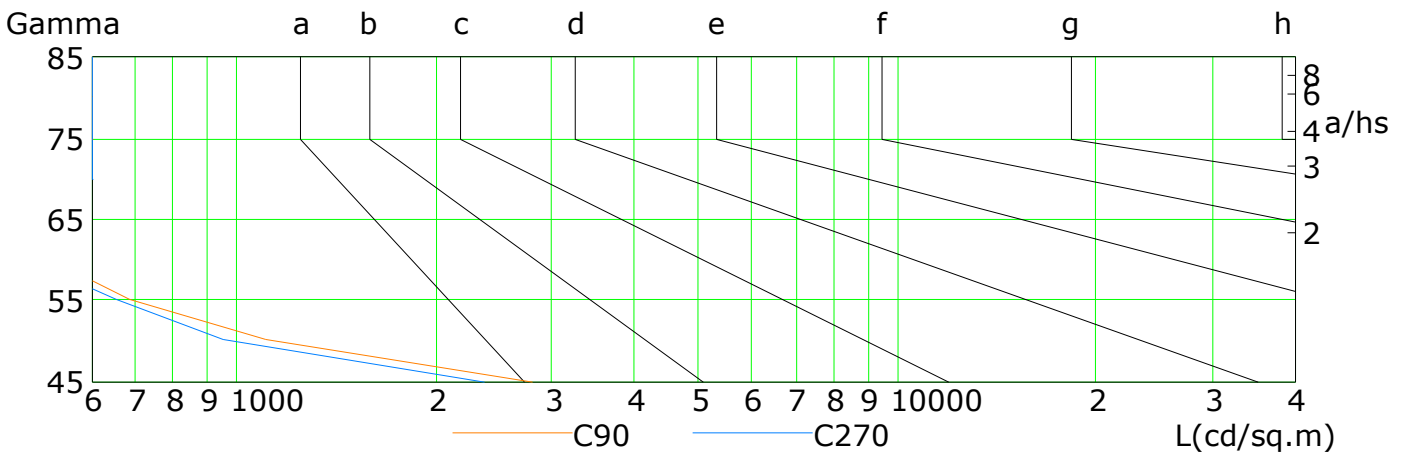


L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	3020	1129	686	522	344	0	0	0	0
C90	2809	1103	686	522	344	46	0	0	0
C180	2200	949	572	488	305	0	0	0	0
C270	2365	949	658	488	305	0	0	0	0


C Plane (°):0.0-360.0: 22.5
 Test Lab: Brasled
 Test Type: TYPE C
 Temperature: 26
 Operator:

Gamma Plane (°):0.0-90.0:5.0
 Test Device: LSG-1200A
 Distance: 1.0 m
 Humidity: 60
 Inspector:

Illuminance at a Distance

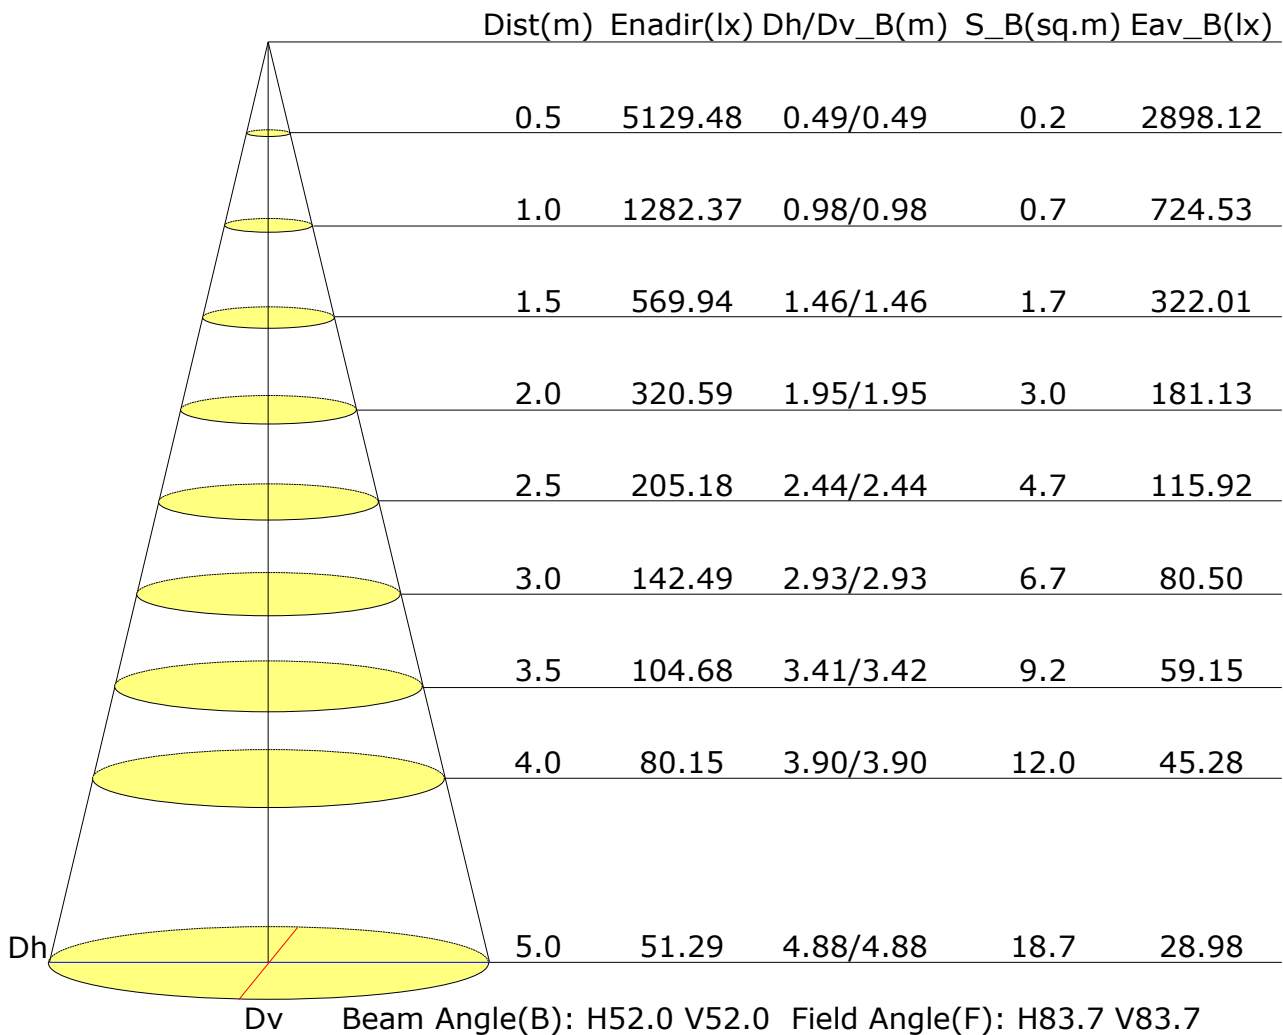

Vertical IsoLux Plot

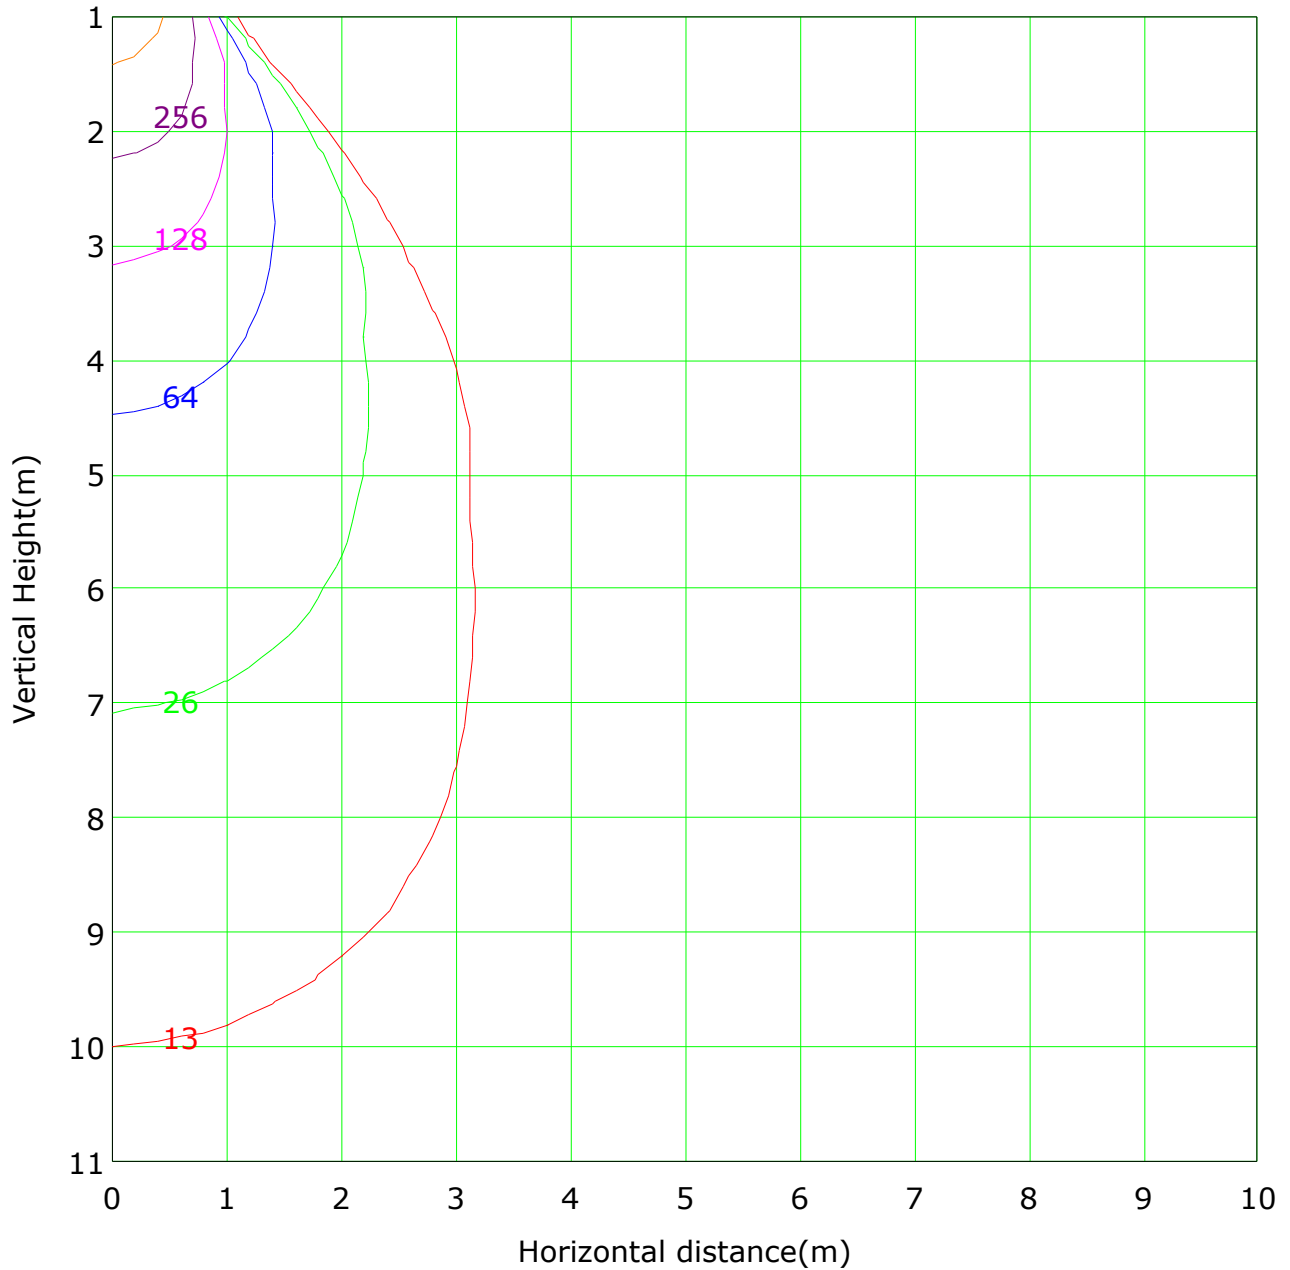

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 1282.4 lx

— (1%): 12.8 lx	— (2%): 25.6 lx
— (5%): 64.1 lx	— (10%): 128.2 lx
— (20%): 256.5 lx	— (50%): 641.2 lx
— (100%):1282.4 lx	

The Average Illuminance Effective Figure

